


NOTES:

1. VALVE BOX SHALL BE SET 1/4" BELOW ASPHALT SURFACE. AND NOT LOCATED WITHIN THE CURB SECTION
2. CONCRETE PAD UNDER HEEL SHALL BE MIN. 4"X15"X15" AND CAN BE EITHER PRECAST OR POURED ON SITE.
3. GRAVEL OR 1" DRAIN ROCK UNDER HEEL SHALL EXTEND A MIN. 6" ABOVE ANY WEEP HOLES.
4. FIRE HYDRANT SHALL BE "WATEROUS" WB-67, OR "MUELLER" SUPER CENTURION.
5. FINISHED GROUND WITHIN A 3-FOOT RADIUS OF THE HYDRANT SHALL BE LEVEL AND AT LEAST 2-INCHES AND NO GREATER THAN 6-INCHES BELOW THE BREAKAWAY BOLTS
6. FIRE HYDRANT SHALL BE SUPPLIED WITH A HYDRANT LOCK AND MARKER: USABLUETBOOK HYDRANTLOK #22529, USABLUETBOOK SPRING STEEL MARKER #75193 OR APPROVED EQUAL.
7. HYDRANTS TO BE FITTED WITH 5-INCH STORZ ADAPTORS.

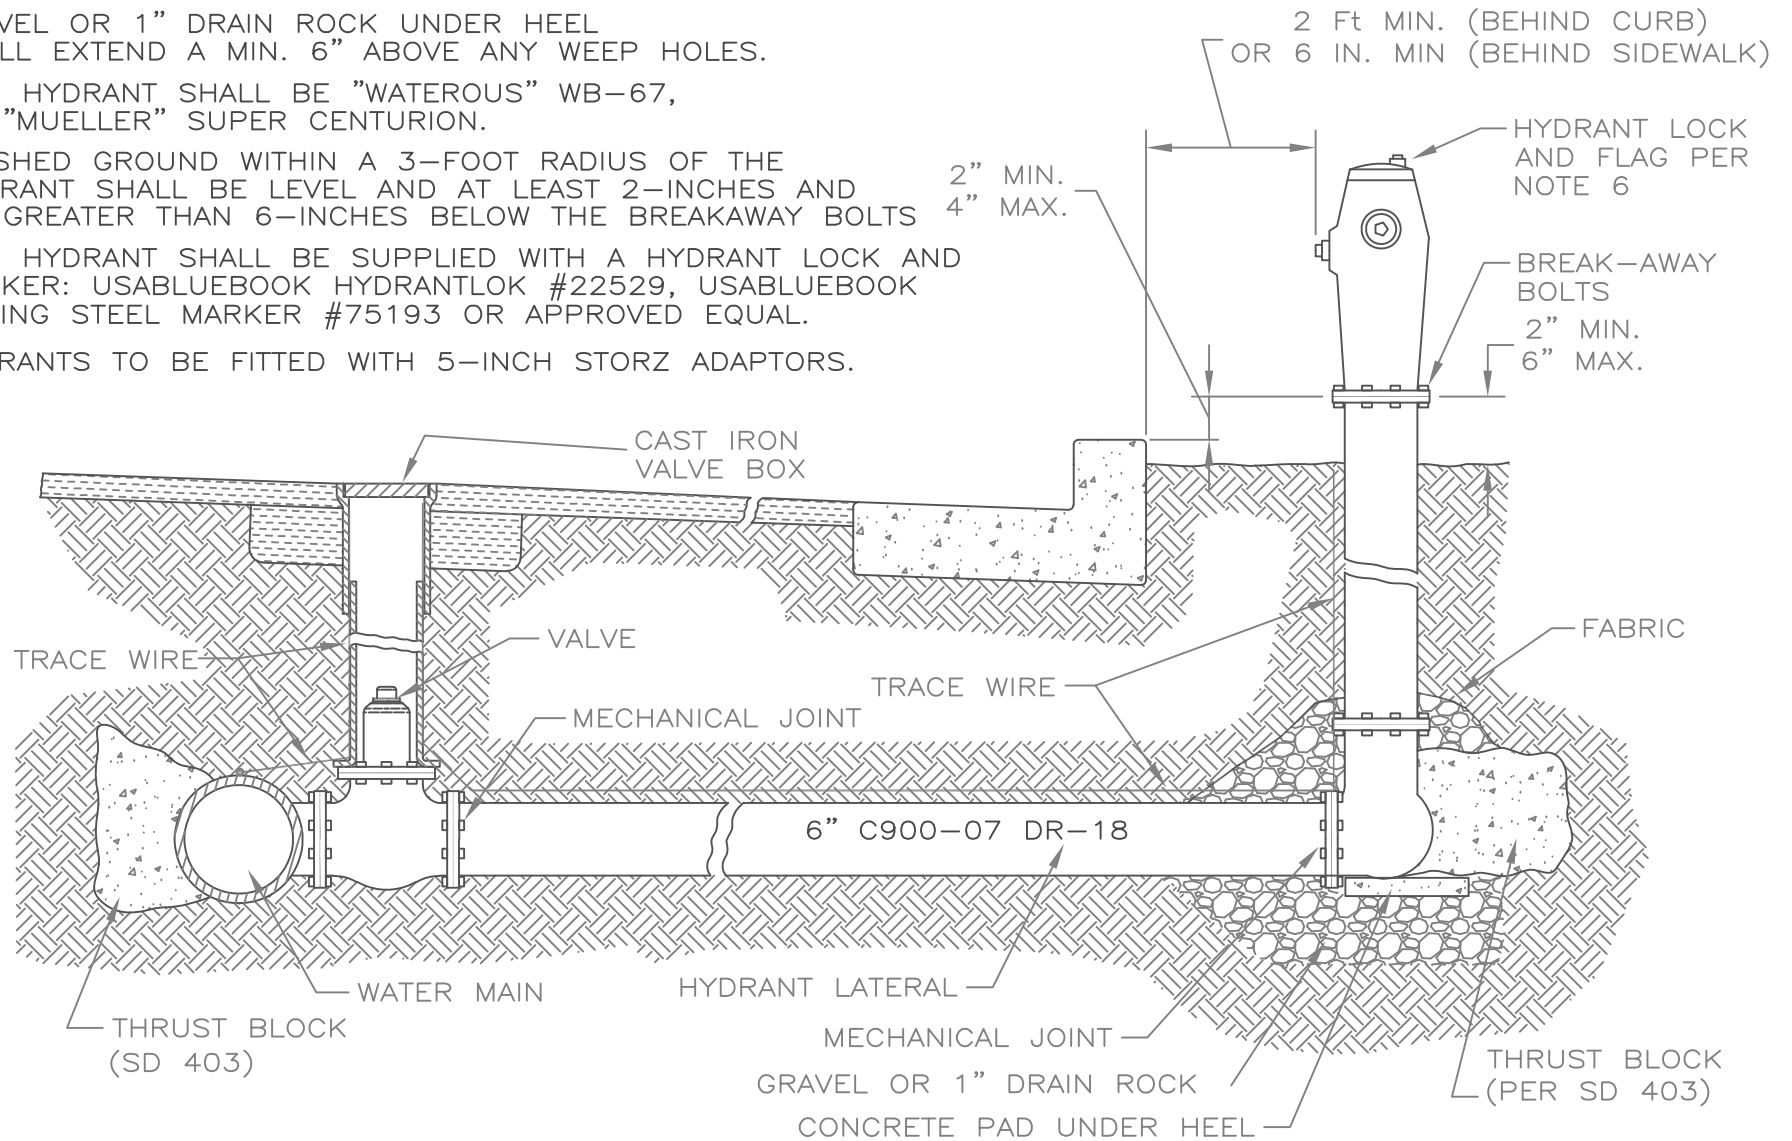

APPROVED BY:

POST FALLS STANDARDS FOR PUBLIC WORKS CONSTRUCTION

*[Signature]* 3/19/19  
 CITY ENGINEER, P.E.      DATE:

**FIRE HYDRANT DETAIL**

STANDARD DRAWING  
 NO. SD 401