


NIPPLE LENGTHS	
2" IRR. SERVICE	- 17 $\frac{1}{4}$ " STUB
2" DOM. SERVICE	- 15 $\frac{1}{4}$ " STUB
1 $\frac{1}{2}$ " SERVICE	- 13 $\frac{1}{4}$ " STUB
1" SERVICE	- 11" STUB
3/4" SERVICE	BUILD TO 1" SPEC WITH ADAPTORS

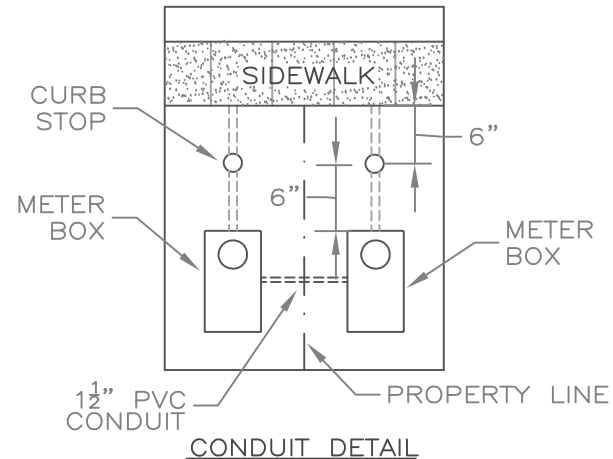

NOTES:

1. ADJACENT METER BOXES SHALL BE CONNECTED BY BORING OR NOTCHING AN OPENING IN THE BOTTOM OF EACH OF THE UPPERMOST METER BOX SECTIONS AND PLACING A 1 $\frac{1}{2}$ " CONDUIT BETWEEN THE BOXES. (SEE CONDUIT DETAIL)
2. METER BOX SHALL BE "ARMOR CAST" 1728 FOR 1" SERVICE, AND 1730 FOR 2" SERVICE, MUELLER ADJUSTA-COIL IS ALSO ACCEPTABLE.
3. VALVE BOX FOR CURB STOP SHALL BE ADJUSTABLE CAST IRON WITH AN EXPANDABLE BOTTOM BUFFALO BOX.
4. ALL SERVICE BRASS SHALL CONFORM TO ANSI/NSF 61 STANDARDS.
5. DUAL SERVICES SHALL UTILIZE A 1 $\frac{1}{2}$ " SERVICE LINE
6. METER LID SHALL BE FLUSH WITH BACK OF WALK(+/- 0.1').
7. ALL BRASS FITTINGS SHALL BE FORD OR MUELLER.

APPROVED BY:

 CITY ENGINEER, P.E. 3/19/19 DATE:

POST FALLS STANDARDS FOR PUBLIC WORKS CONSTRUCTION
WATER SERVICE DETAIL
 (1" - 2")

STANDARD DRAWING
 NO. SD 402